



NOTES

1. NO BENDS OR COUPLING ARE PERMITTED BETWEEN THE MAIN STOP AND THE CURB STOP
2. MAINSTOP SHALL BE 20° TO HORIZONTAL AND GOOSENECK SHALL BE HORIZONTAL.
3. PEX WATER SERVICES WILL NOT BE PERMITTED IN SOILS CONTAMINATED WITH HYDROCARBONS, CHEMICALS OR OTHER POSSIBLE HAZARDS
4. TRACER WIRE TO RUN BETWEEN THE SHOULDER SET SCREW ON THE MAIN STOP TO SHOULDER SET SCREW ON THE CURB STOP. NO SPLICES IN TRACER WIRE ALLOWED.
5. PROFILING MASTIC SHALL BE USED TO PACK ANY VOIDS IN THE SHOULDER SET SCREW. PETROLATUM TAPE TO THEN BE WRAPPED AROUND THE CONNECTION.
6. TRACER WIRE ON THE PRIVATE SIDE SHALL NOT BE CONNECTED TO THE TRACER WIRE OR ANY INFRASTRUCTURE ON THE MUNICIPAL SIDE.

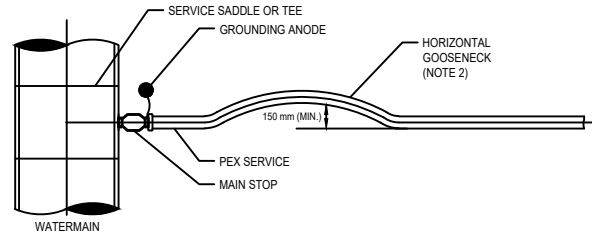

PLAN VIEW

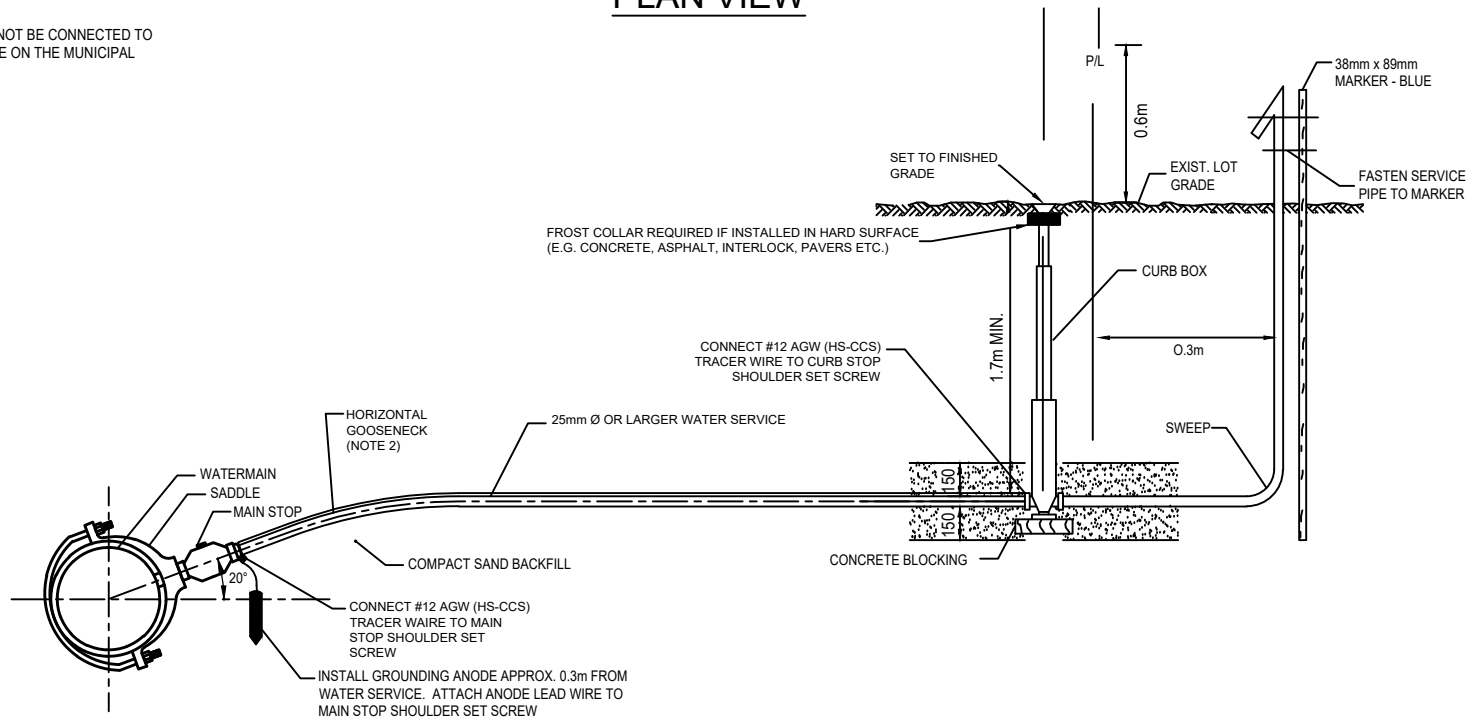

CROSS-LINKED POLYETHYLENE (PEX) WATER SERVICE CONNECTION DETAIL
25mm or LARGER DIAMETER SIZES

DRAWN:	APR'D:
SCALE: N.T.S.	DATE: SEPT 2025

NO.	REVISIONS	APR'D	DATE

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

TOISD
705A